


Connecting to an automated gate

N/C contact from gate/lock timer relay

This example shows the automated gate controller requiring a Normally Closed contact, however, if a Normally Open contact is required then simply use the N/O connection on the gate/lock timer relay board shown

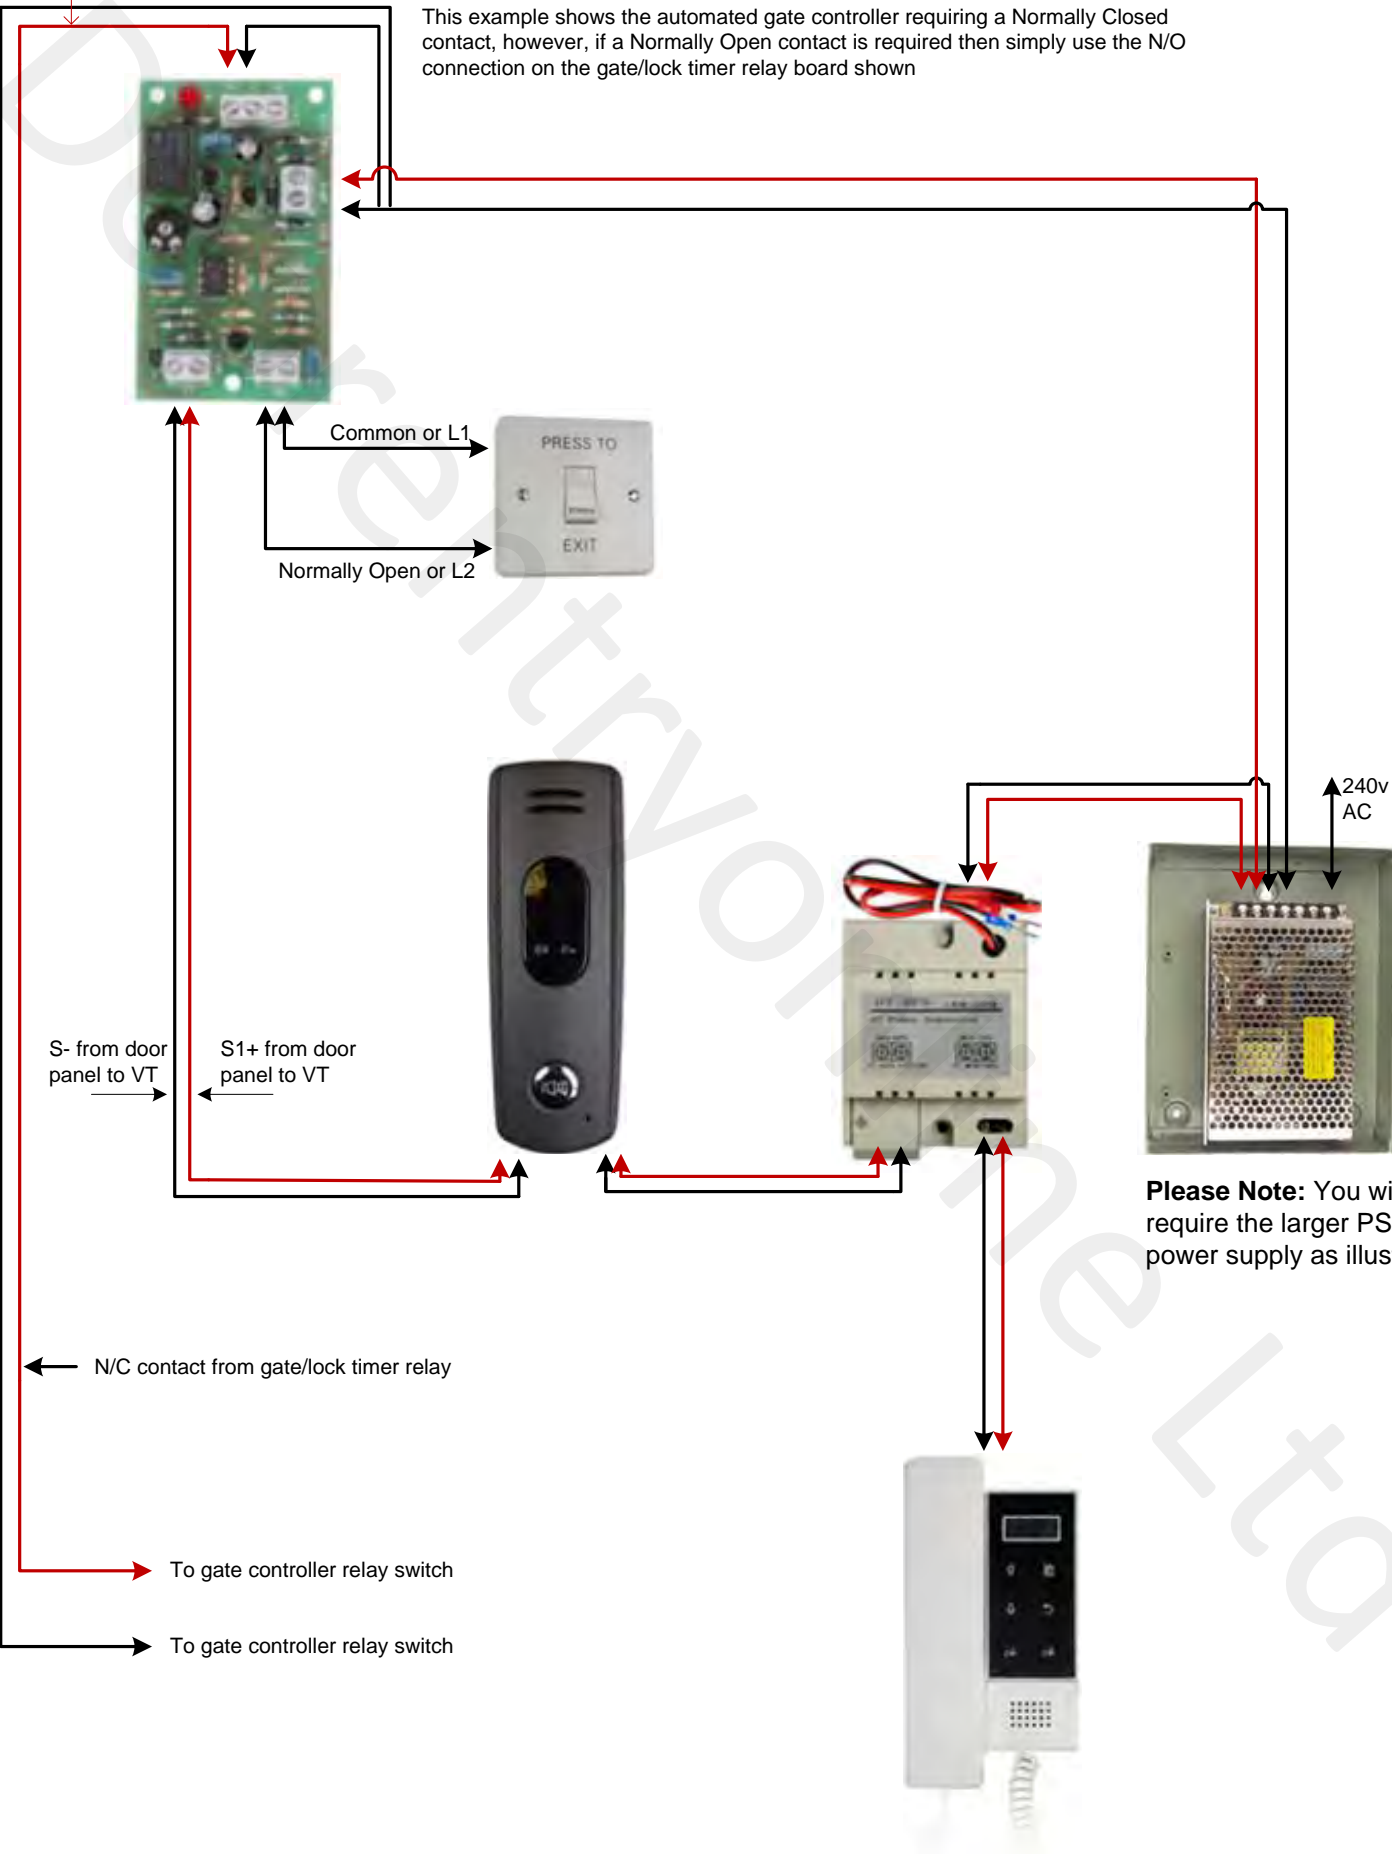

Please Note: You will require the larger PS5 power supply as illustrated